


2014 Florida Energy Efficiency Requirements

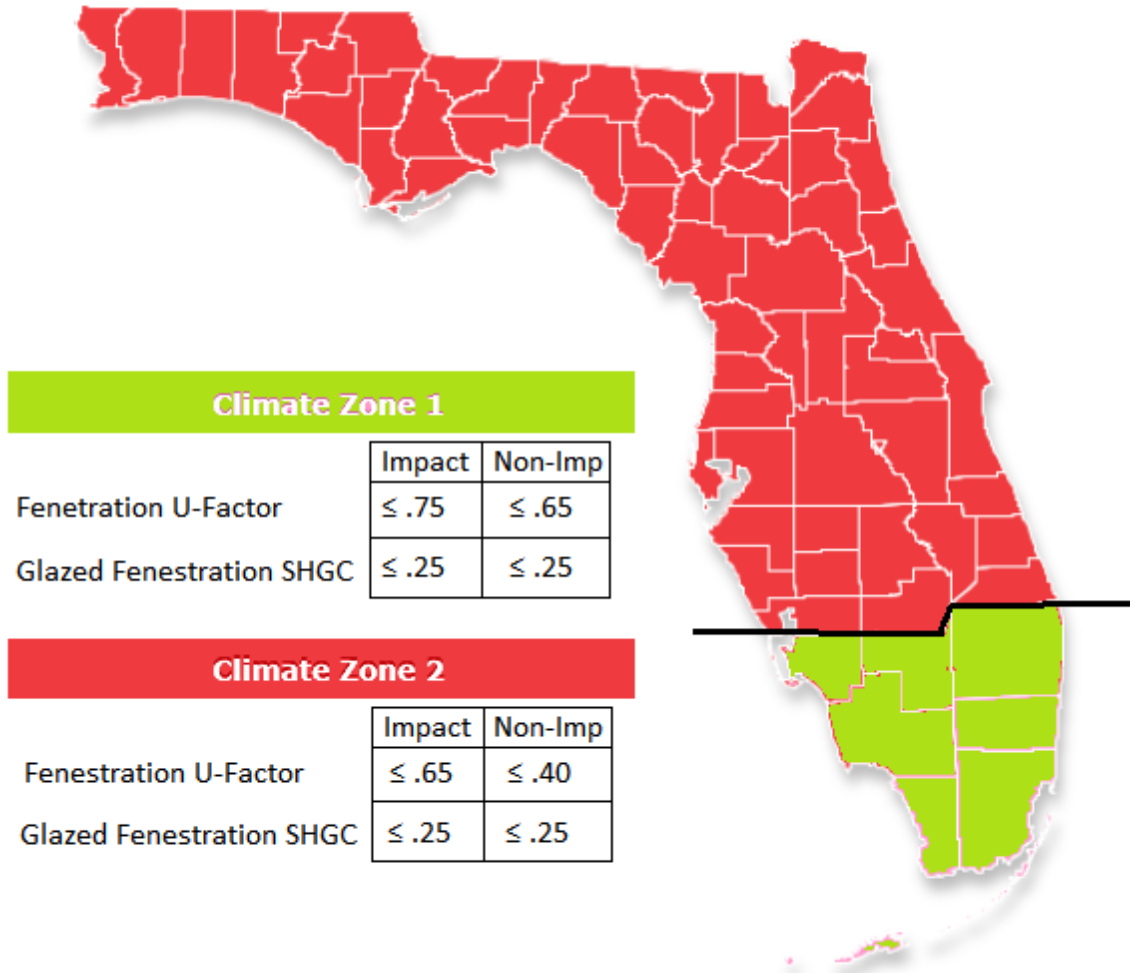

Climate Zone 1

	Impact	Non-Imp
Fenestration U-Factor	≤ .75	≤ .65
Glazed Fenestration SHGC	≤ .25	≤ .25

Climate Zone 2

	Impact	Non-Imp
Fenestration U-Factor	≤ .65	≤ .40
Glazed Fenestration SHGC	≤ .25	≤ .25

Table R402.1.1 (footnote "j") - For impact rated fenestration complying with Section R301.2.1.2 of the *Florida Building Code, Residential* or Section 1609.1.2 of the *Florida Building Code, Building* the maximum U-Factor shall be 0.75 in Climate Zone 1 and 0.65 in Climate Zone 2.

R402.3.3 Glazed fenestration exemption.

Up to 15 square feet (1.4 m²) of glazed fenestration per dwelling unit shall be permitted to be exempt from U-factor and SHGC requirements in Section R402.1.1. This exemption shall not apply to the U-factor alternative approach in Section R402.1.3 and the Total UA alternative in Section R402.1.4.

R402.3.4 Opaque door exemption.

One side-hinged opaque door assembly up to 24 square feet (2.22 m²) in area is exempted from the U-factor requirement in Section R402.1.1. This exemption shall not apply to the U-factor alternative approach in Section R402.1.3 and the total UA alternative in Section R402.1.4.

Useful webpages:

http://search.nfrc.org/search/cpd/cpd_search_productline.aspx

[http://codes.iccsafe.org/app/book/content/2014_Florida/Energy%20Conservation%20Code/Chapter%203\[RE\].html](http://codes.iccsafe.org/app/book/content/2014_Florida/Energy%20Conservation%20Code/Chapter%203[RE].html)

[http://codes.iccsafe.org/app/book/content/2014_Florida/Energy%20Conservation%20Code/Chapter%204\[RE\].html](http://codes.iccsafe.org/app/book/content/2014_Florida/Energy%20Conservation%20Code/Chapter%204[RE].html)